


Login Id: -	emerson	Equipment Id:	EEMEG034-00
Room Name: -	2DG-068 Component Processor Room	Room No: -	2DG-068
Sart Date & Time: -	08/01/2021 14:45	End Date & Time: -	08/01/2021 15:15

E Signatures	
Reviewer Login Id: -	
Date & Time :-	
Verified by: -	
Reviewed by: -	
Date & Time :-	
Approver Comments: -	

DATE & TIME	TEMPERATURE °C 19 - 25	RELATIVE HUMIDITY %RH NMT-60	DIFFERENTIAL PRESSURE 18-32 (Pa)
08/01/2021 14:45	50.0	30	38
08/01/2021 14:46	50.0	30	38
08/01/2021 14:47	50.0	30	38
08/01/2021 14:48	50.0	30	38
08/01/2021 14:49	50.0	30	38
08/01/2021 14:50	50.0	30	38
08/01/2021 14:51	50.0	30	38
08/01/2021 14:52	50.0	30	38
08/01/2021 14:53	50.0	30	38
08/01/2021 14:54	50.0	30	38
08/01/2021 14:55	50.0	30	38
08/01/2021 14:56	50.0	30	38
08/01/2021 14:57	50.0	30	38
08/01/2021 14:58	50.0	30	38
08/01/2021 14:59	50.0	30	38
08/01/2021 15:00	50.0	30	38
08/01/2021 15:01	50.0	30	38
08/01/2021 15:02	50.0	30	38
08/01/2021 15:03	50.0	30	38
08/01/2021 15:04	50.0	30	38

Login Id: -	emerson	Equipment Id:	EEMEG034-00
Room Name: -	2DG-068 Component Processor Room	Room No: -	2DG-068
Sart Date & Time: -	08/01/2021 14:45	End Date & Time: -	08/01/2021 15:15

DATE & TIME	TEMPERATURE °C 19 - 25	RELATIVE HUMIDITY %RH NMT-60	DIFFERENTIAL PRESSURE 18-32 (Pa)
08/01/2021 15:05	50.0	30	38
08/01/2021 15:06	50.0	30	38
08/01/2021 15:07	50.0	30	38
08/01/2021 15:08	50.0	30	38
08/01/2021 15:09	50.0	30	38
08/01/2021 15:10	50.0	30	38
08/01/2021 15:11	50.0	30	38
08/01/2021 15:12	50.0	30	38
08/01/2021 15:13	50.0	30	38
08/01/2021 15:14	50.0	30	38
Min	50.0	30	38
Avg	50.0	30	38
Max	50.0	30	38

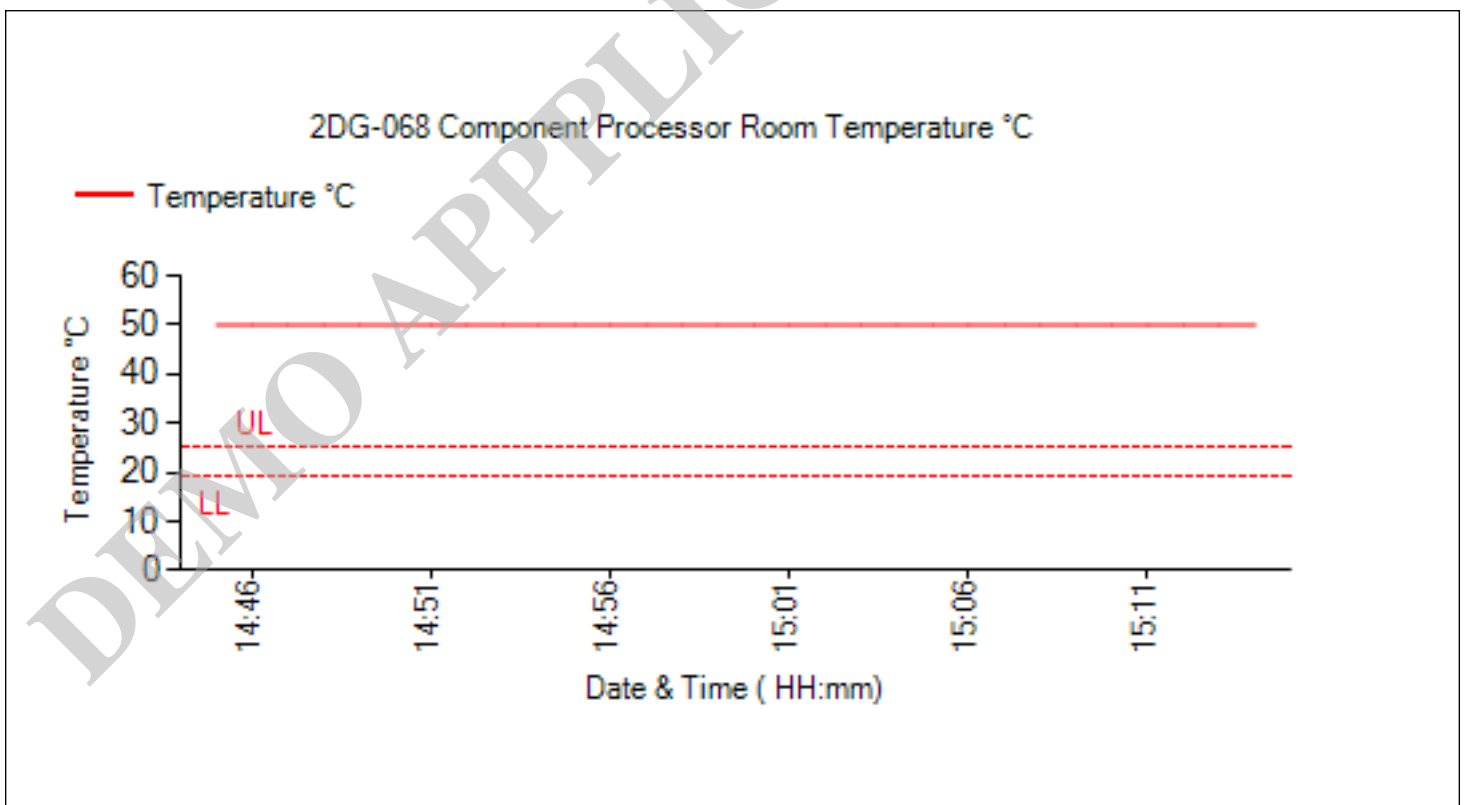

Login Id: -	emerson	Equipment Id:	EEMEG034-00
Room Name: -	2DG-068 Component Processor Room	Room No: -	2DG-068
Sart Date & Time: -	08/01/2021 14:45	End Date & Time: -	08/01/2021 15:15

